


GENERAL NOTES

- ① - SYSTEM CONTROL PANEL WITH SINGLE POINT POWER CONNECTION, SEE PLANS FOR FINAL LOCATION AND ORIENTATION.
- ② - ANSI FLANGE CLASS 150 CONNECTION TO 316SS MANIFOLD. PROVIDE A MINIMUM OF ONE NOMINAL FLANGE DIAMETER LENGTH FROM FLANGE TO EXPANSION JOINT ON BOTH SUCTION AND DISCHARGE. SEE PLANS FOR COORDINATED CONFIGURATION AND SIZE.
- ③ - ISOLATION VALVE, TWO PER PUMP.
- ④ - SPRING-LOADED NON-SLAME TYPE CHECK VALVE, ONE FOR EACH PUMP.
- ⑤ - FACTORY INSTALLED PRESSURE TRANSDUCER ON DISCHARGE MANIFOLD.
- ⑥ - TWO FACTORY INCLUDED 2.5"Ø PRESSURE GAUGE, ONE ON SUCTION AND ONE ON DISCHARGE.
- ⑦ - 304 SS BASE FRAME WITH RUBBER VIBRATION DAMPENERS FITTED BETWEEN EACH PUMP AND THE BASE FRAME.
- ⑧ - SHIPPED LOOSE, FIELD INSTALLED HYDROMATIC EXPANSION TANK. INCLUDE ISOLATION VALVE AND BLEED VALVE WITH EXPANSION TANK INSTALLATION.



1 TRIPLEX BOOSTER PUMP DETAIL AND SCHEMATIC
SCALE: NTS

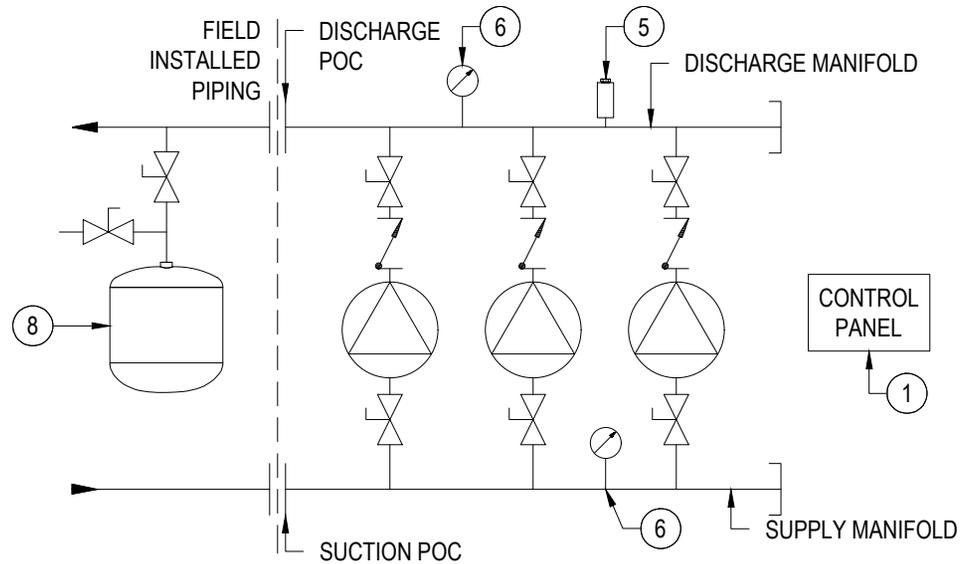

DRAWING TITLE:
**GRUNDFOS HYDRO MPC-E TRIPLEX BOOSTER
DETAIL AND SCHEMATIC**

DRAWING NUMBER:
000001-B

DRAWN BY BM	LAST REVISED 12/15/2021	DRAWING SCALE NTS
-----------------------	-----------------------------------	-----------------------------

THE DOCUMENT AND ALL INFORMATION SHOWN IS PROPERTY OF HURLEY ENGINEERING, INC. THIS DOCUMENT IS NOT TO BE REDISTRIBUTED OR COPIED OR USED FOR THE MANUFACTURING OF EQUIPMENT WITHOUT PRIOR WRITTEN CONSENT FROM HURLEY ENGINEERING, INC.

QR CODE